24/90

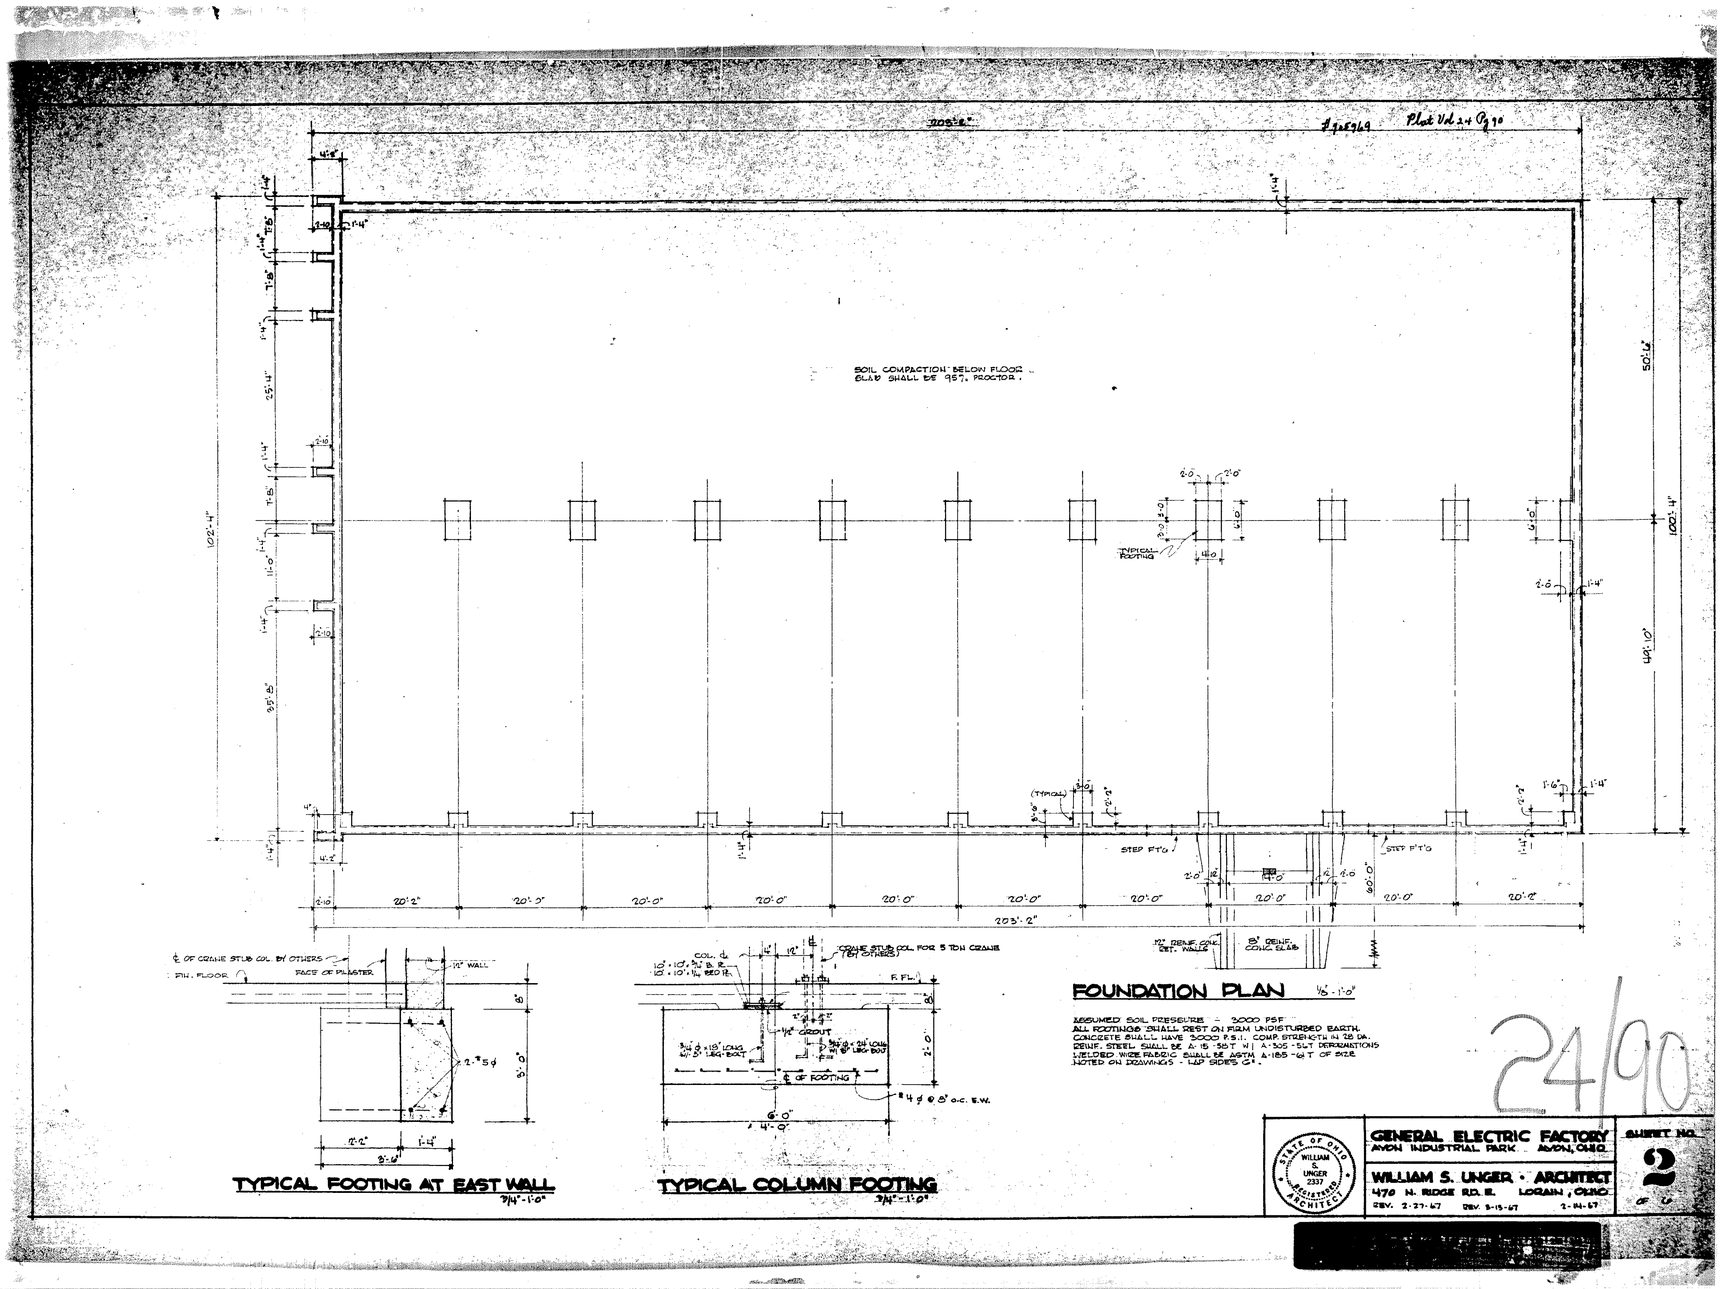

TYPICAL FOOTING AT EAST WALL
3/4"-1'-0"

TYPICAL COLUMN FOOTING
3/4"-1'-0"

FOUNDATION PLAN
1/8"-1'-0"

ASSUMED SOIL PRESSURE = 3000 PSF
ALL FOOTINGS SHALL REST ON FIRM UNDISTURBED EARTH.
CONCRETE SHALL HAVE 3000 P.S.I. COMP. STRENGTH IN 28 DA.
REINF. STEEL SHALL BE A-15 SST W.I. A-305 - SLT DEFORMATIONS
WELDED WIRE FABRIC SHALL BE ASTM A-185 - 6"T OF SIDE
NOTED ON DRAWINGS - LAP SIDES 6".

24/90

WILLIAM S. UNGER 2337 REGISTERED ARCHITECT STATE OF OHIO

GENERAL ELECTRIC FACTORY
AVON INDUSTRIAL PARK AVON, OHIO

WILLIAM S. UNGER • ARCHITECT
470 N. RIDGE RD. E. LORAIN, OHIO
REV. 2-27-67 REV. 3-15-67 2-14-67

SHEET NO. 2 OF 6

[redacted]

24/90