6-110

6-112-3 THE MEADOWS OF ELYRIA CONDOMINIUM
PLAT Vol. 35 Pages 27 thru 37

#11569

APPROVED
LORAIN CO.
MAP DEPT.
DATE 9/21/78
PAGE 6-110
BY T. McNair
VOID AFTER 11569

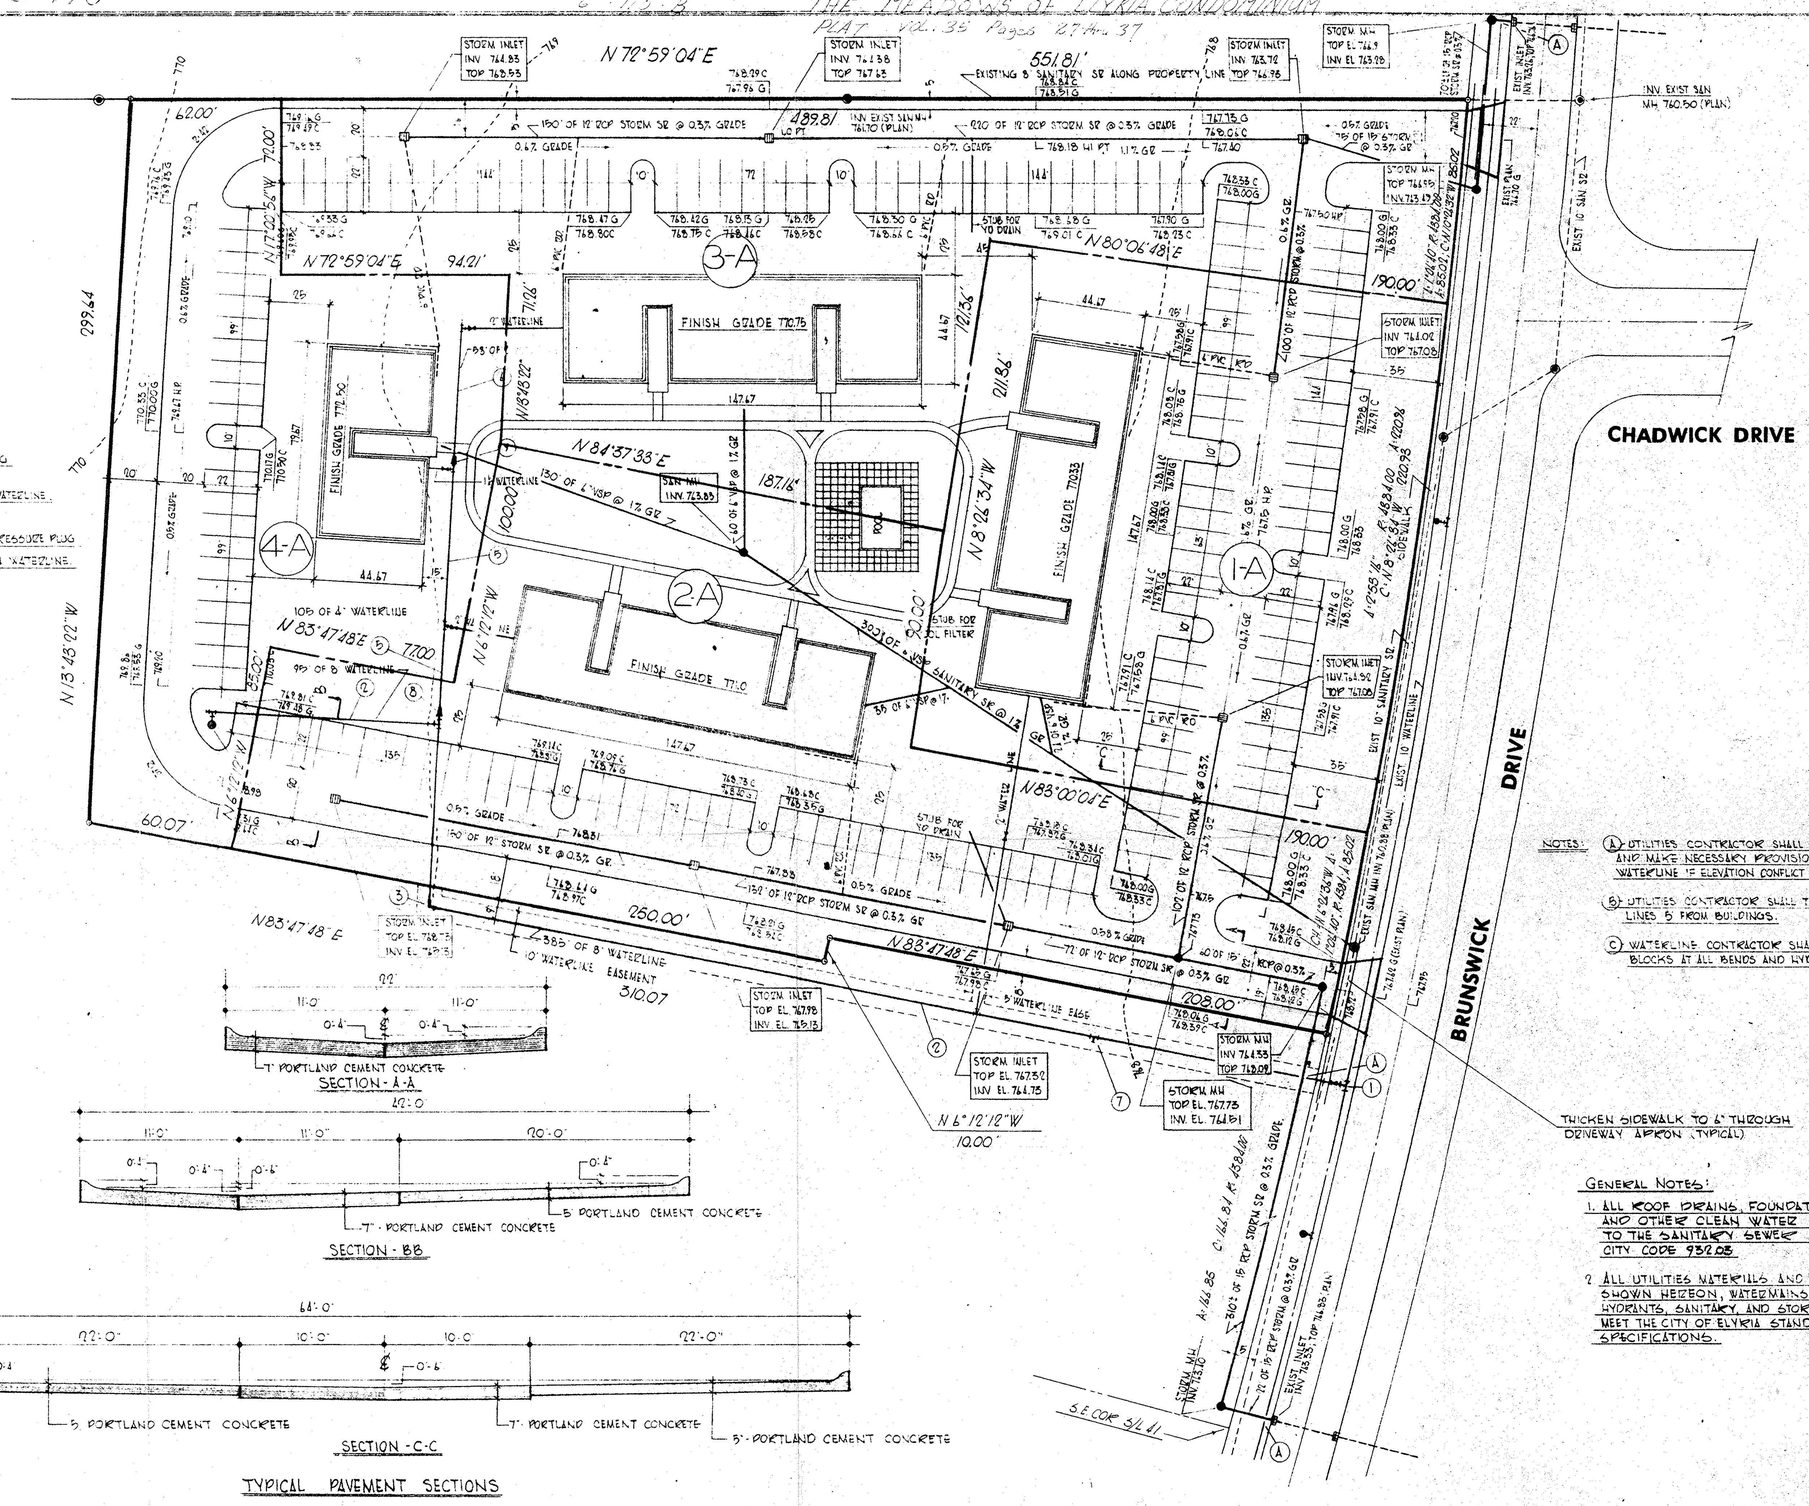

WATERLINE CONSTRUCTION NOTES:

1. BEGIN CONSTRUCTION, INSTALL 10 x 8" TAPPING SLEEVE AND VALVE. TAP EXIST. 10" WATERLINE.
2. INSTALL NEW 8" CAST IRON OR DUCTILE IRON WATERLINE.
3. INSTALL NEW 8" 90° M.J. BEND.
4. INSTALL NEW HYDRANT, VALVE, AND TEE WITH PRESSURE PLUG.
5. INSTALL NEW 8" CAST IRON OR DUCTILE IRON WATERLINE.
6. INSTALL NEW 8" DUCTILE IRON WATERLINE.
7. INSTALL NEW 8" TEE WITH PRESSURE PLUG.
8. INSTALL NEW 8 x 4 REDUCER.
9. INSTALL NEW 4 x 2 REDUCER.

(C) PLACE WATERLINE MIN 5' BELOW GRADE

NOTES:

(A) UTILITIES CONTRACTOR SHALL CONTACT CITY WATER DEPT. AND MAKE NECESSARY PROVISIONS FOR LOWERING EXISTING WATERLINE IF ELEVATION CONFLICT EXISTS WITH NEW STORM SEWER.

(B) UTILITIES CONTRACTOR SHALL TERMINATE ALL UTILITIES SERVICE LINES 5' FROM BUILDINGS.

(C) WATERLINE CONTRACTOR SHALL PROVIDE NECESSARY THRUST BLOCKS AT ALL BENDS AND HYDRANTS.

GENERAL NOTES:

1. ALL ROOF DRAINS, FOUNDATION DRAINS AND OTHER CLEAN WATER CONNECTIONS TO THE SANITARY SEWER ARE PROHIBITED CITY CODE 937.05
2. ALL UTILITIES MATERIALS AND INSTALLATION SHOWN HEREON, WATERMAINS, BLOCKING, FIRE HYDRANTS, SANITARY, AND STORM SEWERS SHALL MEET THE CITY OF ELYRIA STANDARDS AND SPECIFICATIONS.

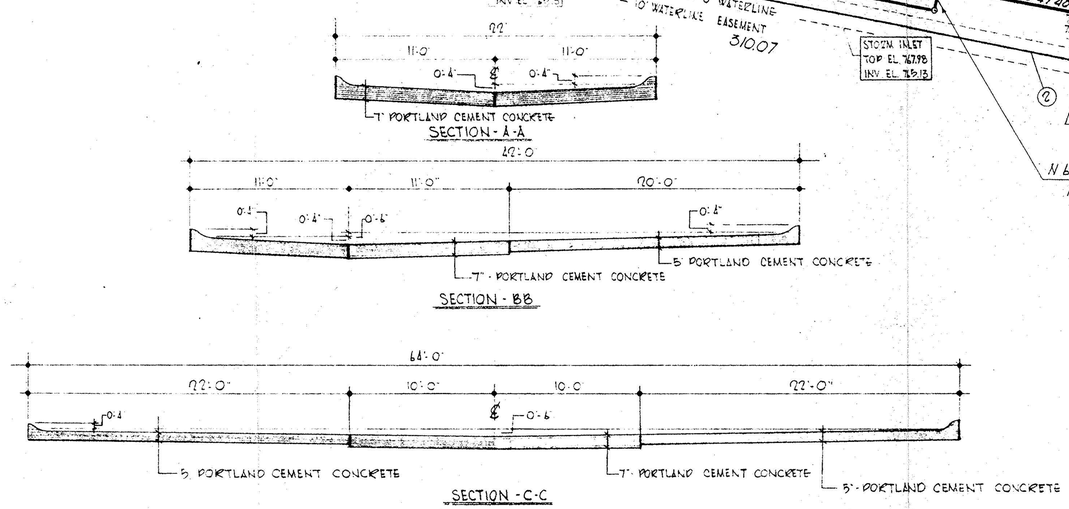

TYPICAL PAVEMENT SECTIONS

REVISED 11-25-77
REVISED 10-21-77
REVISED 10-6-77

THE MATHESON COMPANY	PROPOSED BRUNSWICK MEADOWS	ELYRIA OHIO - SEPTEMBER 1977 - SCALE 1" = 30'