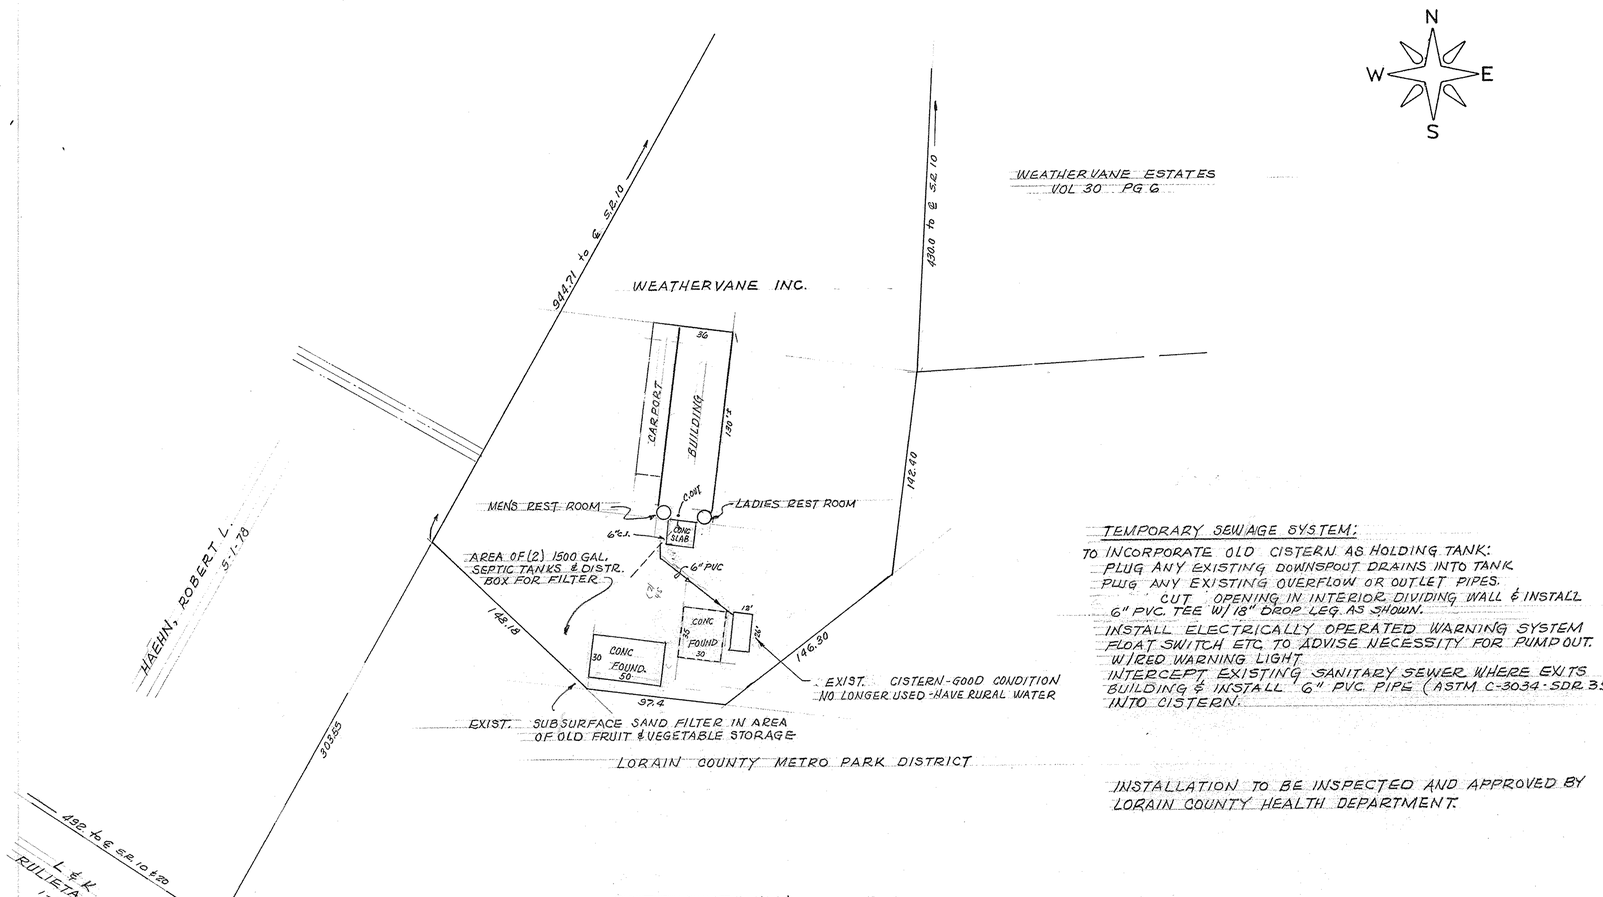

SITE PLAN
1" = 50'

TEMPORARY SEWAGE SYSTEM:

TO INCORPORATE OLD CISTERN AS HOLDING TANK:
PLUG ANY EXISTING DOWNSPOUT DRAINS INTO TANK
PLUG ANY EXISTING OVERFLOW OR OUTLET PIPES.
CUT OPENING IN INTERIOR DIVIDING WALL & INSTALL 6" PVC TEE W/ 18" DROP LEG AS SHOWN.
INSTALL ELECTRICALLY OPERATED WARNING SYSTEM FLOAT SWITCH ETC TO ADVISE NECESSITY FOR PUMP OUT. W/RED WARNING LIGHT
INTERCEPT EXISTING SANITARY SEWER WHERE EXITS BUILDING & INSTALL 6" PVC PIPE (ASTM C-3034-SDR 35) INTO CISTERN.

INSTALLATION TO BE INSPECTED AND APPROVED BY LORAIN COUNTY HEALTH DEPARTMENT.

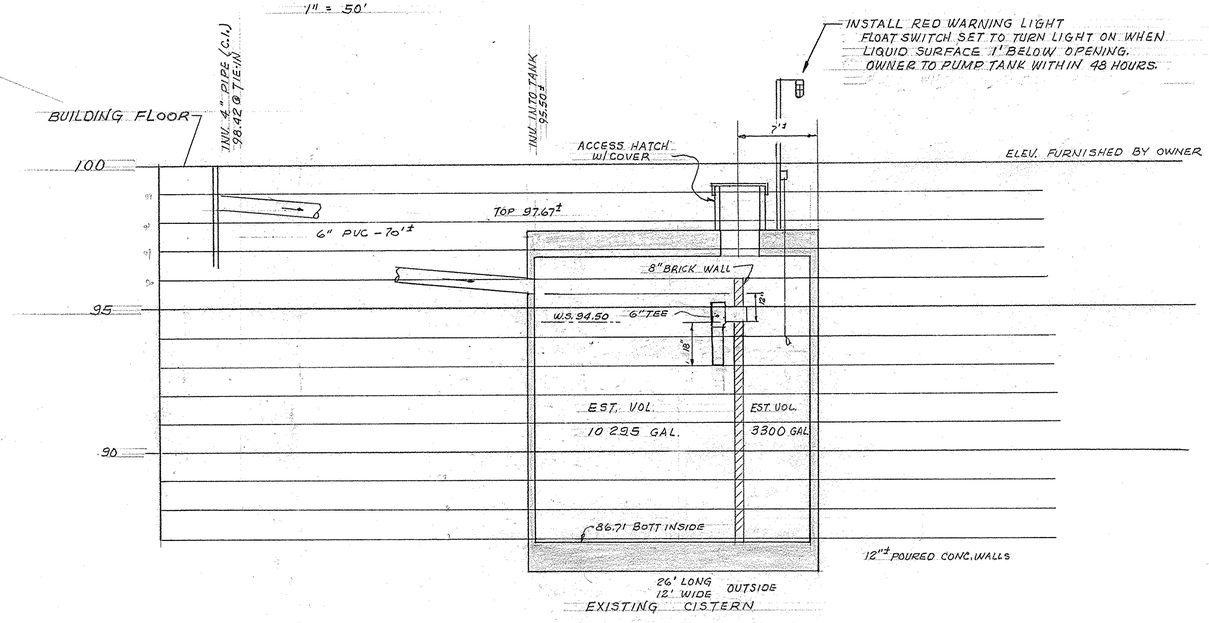

SYSTEM PROFILE
SCALE: HORIZ: NONE VERT: 1" = 2.5'

APPROVALS:

OHIO EPA	DATE
LORAIN COUNTY HEALTH DEPT.	DATE
FOR WEATHERVANE INC	DATE

PROPOSED
TEMPORARY MODIFICATIONS TO
WASTEWATER TREATMENT SYSTEM
FOR
WEATHERVANE INC.
BUTTERNUT RIDGE ROAD
CARLISLE TWP SECTION 12
LORAIN COUNTY, OHIO

McGLINCHY AND ASSOCIATES
PROFESSIONAL ENGINEERS AND SURVEYORS
110½ MIDDLE AVENUE ELYRIA, OHIO

SCALE: AS NOTED DRAWN BY: DON
DATE: JAN. 1985 JOB NO: 858618